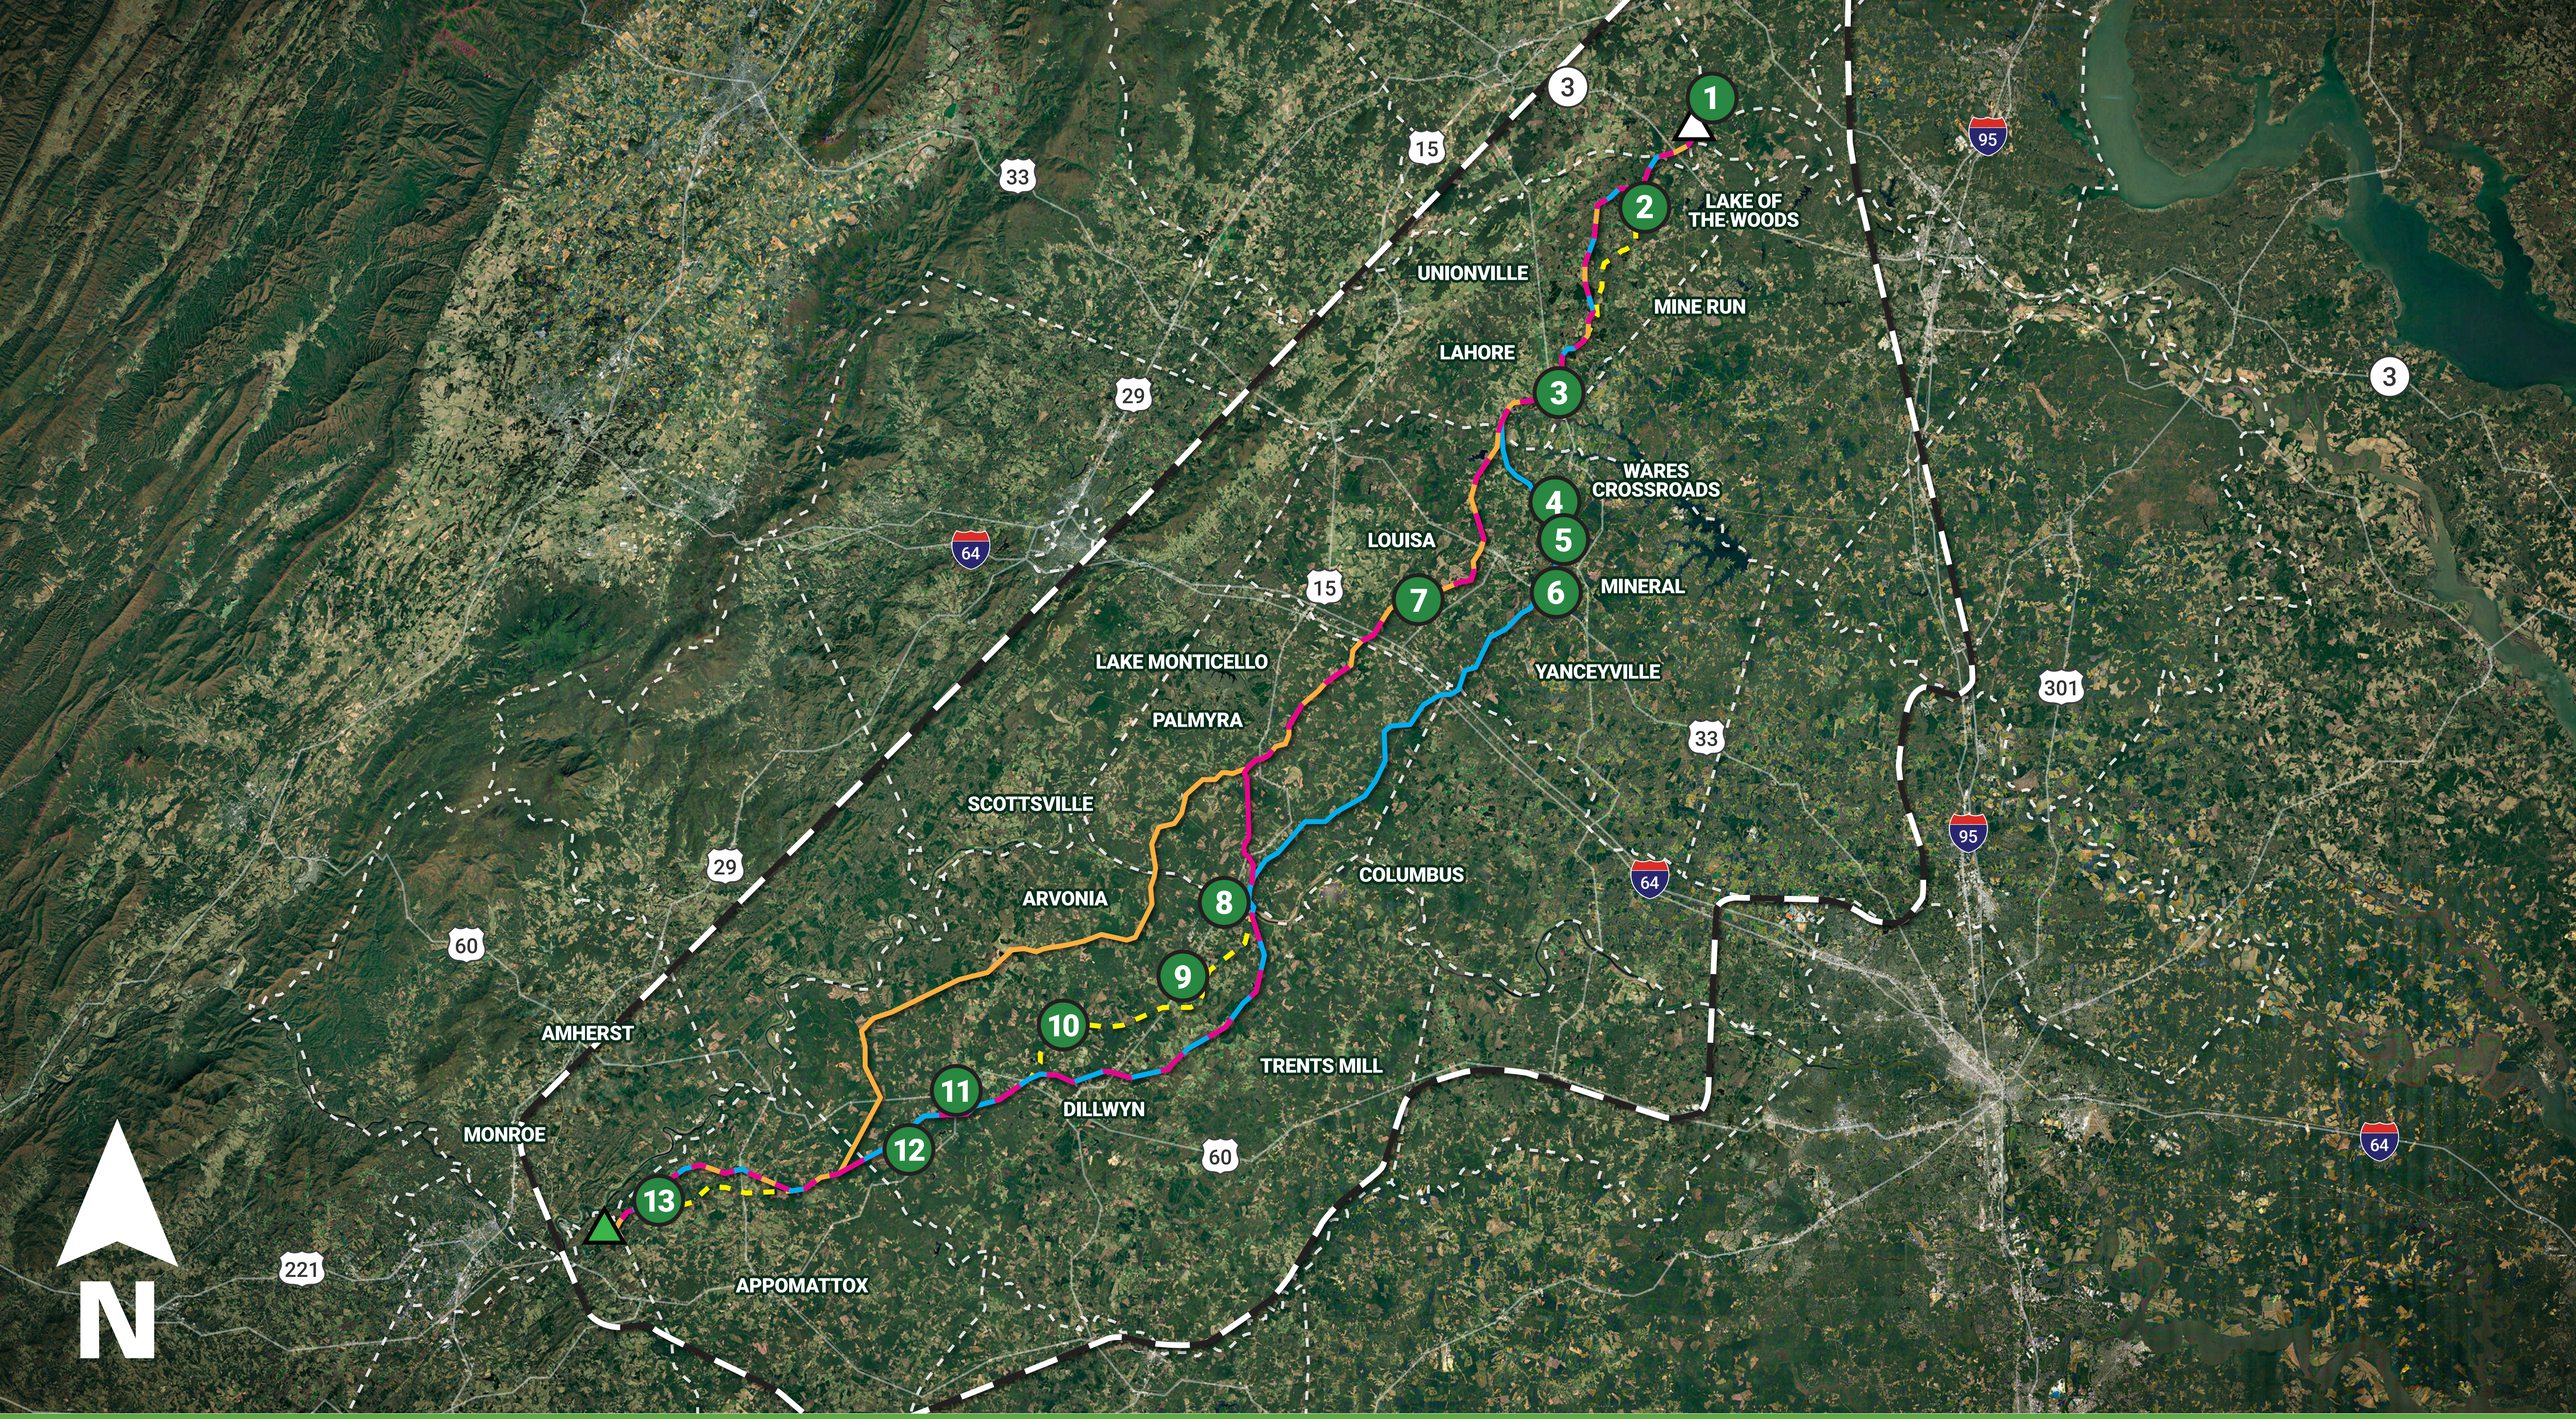


Joshua Falls to Yeat

765kV Electric Transmission Line Project

Photo Location Map

- 1 Viewpoint Location
- Existing Substation
- Proposed Substation
- Study Area
- Route 1
- Route 2
- Route 3
- County Line
- Gold Hill Variation, Mine Run Variation, Appomatox Variation

valley link SM

Existing Conditions

Proposed Conditions

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.

Joshua Falls to Yeat

765kV Electric Transmission Line Project

Viewpoint 1

Date: 12/31/2025 **Time:** 8:11 am **Viewing Direction:** South
Crossroad: Elys Ford Rd **Distance to Centerline:** 1025 Feet

1 Viewpoint Location △ Proposed Substation
Route 1 Route 2 Route 3



valley link℠

Existing Conditions

Proposed Conditions **OVERLAY**

Objects displayed in yellow will be fully obscured by terrain and vegetation.

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.

Joshua Falls to Yeat

765kV Electric Transmission Line Project

Viewpoint 1

Date: 12/31/2025 **Time:** 8:11 am **Viewing Direction:** South
Crossroad: Elys Ford Rd **Distance to Centerline:** 1025 Feet

1 Viewpoint Location △ Proposed Substation
Route 1 Route 2 Route 3



valley link SM





Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.


Joshua Falls to Yeat

765kV Electric Transmission Line Project

Viewpoint 2

Date: 10/2/2025 **Time:** 10:34 am **Viewing Direction:** West
Crossroad: Zoar Rd **Distance to Centerline:** 290 Feet

2 Viewpoint Location — Mine Run Variation

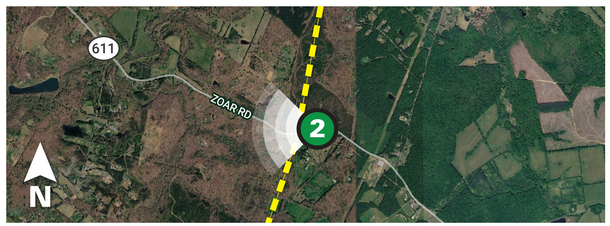

valley link℠

Existing Conditions

Proposed Conditions

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.


Joshua Falls to Yeat

765kV Electric Transmission Line Project

Viewpoint 3

Date: 10/3/2025 **Time:** 9:24 am **Viewing Direction:** Northwest
Crossroad: Thornhill Rd **Distance to Centerline:** 3/4 Mile
Distance to Existing Cell Tower: 2/3 Mile **Existing Cell Tower Height:** ~250 feet

3 Viewpoint Location — Route 1 — Route 2 — Route 3

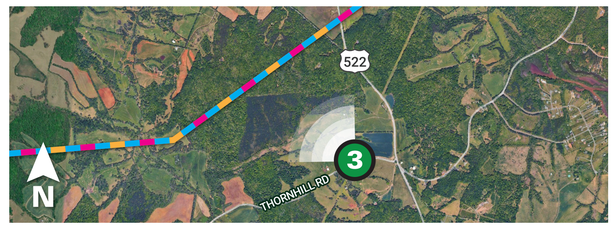

valley link℠

Existing Conditions

Proposed Conditions

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.

Joshua Falls to Yeat

765kV Electric Transmission Line Project

Viewpoint 4

Date: 10/4/2025 **Time:** 9:57 am **Viewing Direction:** West

Crossroad: Shortmans Rd **Distance to Centerline:** 225 Feet

4 Viewpoint Location — Route 2



valley link SM

Existing Conditions

Proposed Conditions

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.

Joshua Falls to Yeat

765kV Electric Transmission Line Project

Viewpoint 5

Date: 4/16/2026 **Time:** 3:08 pm **Viewing Direction:** West

Crossroad: Louisa County Middle School **Distance to Centerline:** 1/4 Mile

5 Viewpoint Location — Route 2



valley link SM

Existing Conditions

Proposed Conditions **OVERLAY**

Objects displayed in yellow will be fully or partially obscured by terrain and vegetation.

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.

Joshua Falls to Yeat

765kV Electric Transmission Line Project

Viewpoint 5

Date: 4/16/2026 **Time:** 3:08 pm **Viewing Direction:** West

Crossroad: Louisa County Middle School **Distance to Centerline:** 1/4 Mile

5 Viewpoint Location — Route 2



valley link SM

Existing Conditions

Proposed Conditions **OVERLAY**

Objects displayed in yellow will be fully obscured by terrain and vegetation.

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.

Joshua Falls to Yeat

765kV Electric Transmission Line Project

Viewpoint 6

Date: 10/4/2025 **Time:** 10:30 am **Viewing Direction:** West

Crossroad: Northeast Creek Resevoir **Distance to Centerline:** 2/3 Mile

6 Viewpoint Location — Route 2



valley link SM

Existing Conditions

Proposed Conditions

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.


Joshua Falls to Yeat

765kV Electric Transmission Line Project

Viewpoint 7

Date: 12/30/2025 **Time:** 11:48 am **Viewing Direction:** Northeast
Crossroad: E Jack Jouett Rd **Distance to Centerline:** 3/4 Mile

7 Viewpoint Location — Route 1 — Route 3

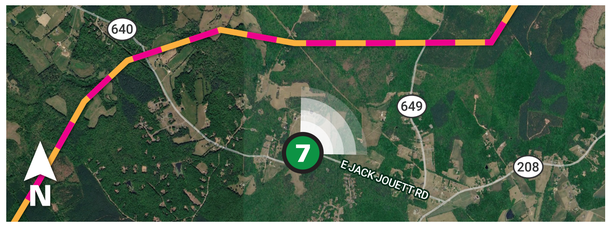

valley link SM

Existing Conditions

Aerial simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.

Joshua Falls to Yeat


765kV Electric Transmission Line Project

Viewpoint 8

Date: 10/8/2025 **Time:** 1:05 pm **Viewing Direction:** East

Crossroad: New Canton/Bremo Bluff

8 Viewpoint Location — Route 2 — Route 3

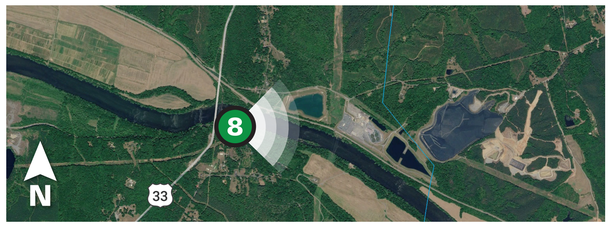

valley link SM

Proposed Conditions

Aerial simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.

Joshua Falls to Yeat


765kV Electric Transmission Line Project

Viewpoint 8

Date: 10/8/2025 **Time:** 1:05 pm **Viewing Direction:** East

Crossroad: New Canton/Bremo Bluff **Distance to Centerline:** 3/4 Mile

8 Viewpoint Location — Route 2 — Route 3

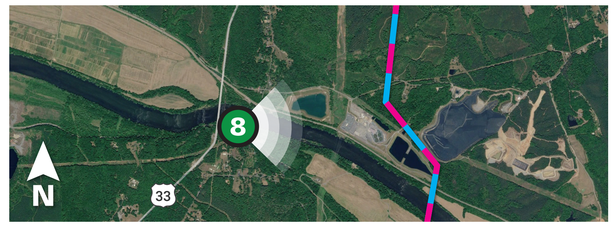

valley link SM

Existing Conditions

Proposed Conditions **OVERLAY**

Objects displayed in yellow will be fully obscured by terrain and vegetation.

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.


Joshua Falls to Yeat

765kV Electric Transmission Line Project

Viewpoint 9

Date: 10/8/2025 **Time:** 11:35 am **Viewing Direction:** South
Crossroad: N James Madison Hwy & Gold Hill Elementary School Rd
Distance to Centerline: 1.5 Mile

9 Viewpoint Location — Gold Hill Variation

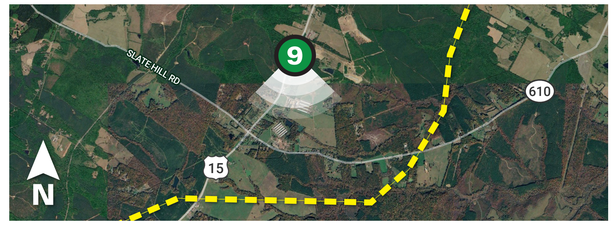

valley link SM

Existing Conditions

Proposed Conditions

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.

Joshua Falls to Yeat


765kV Electric Transmission Line Project

Viewpoint 10

Date: 10/8/2025 **Time:** 3:17 pm **Viewing Direction:** Southeast

Crossroad: Banton Shop Rd & State River Mill Rd **Distance to Centerline:** 500 Feet

10 Viewpoint Location — Gold Hill Variation

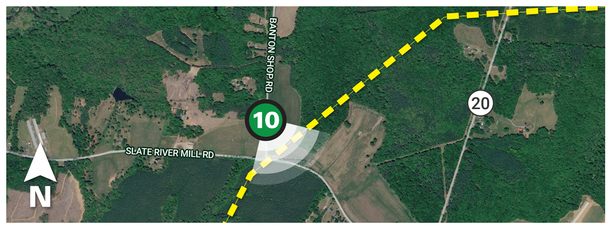

valley link SM

Existing Conditions

Proposed Conditions **OVERLAY**

Objects displayed in yellow will be fully obscured by terrain and vegetation.

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.

Joshua Falls to Yeat


765kV Electric Transmission Line Project

Viewpoint 11

Date: 10/8/2025 **Time:** 4:05 pm **Viewing Direction:** Southeast

Crossroad: W James Anderson Hwy **Distance to Centerline:** 1 Mile

11 Viewpoint Location — Route 2 — Route 3

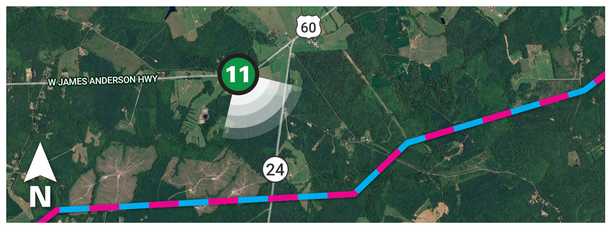

valley link SM



Existing Conditions



Proposed Conditions

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.

Joshua Falls to Yeat

765kV Electric Transmission Line Project

Viewpoint 12

Date: 10/9/2025 **Time:** 9:34 am **Viewing Direction:** Northwest

Crossroad: Austin Rd & Seay Farm Ln **Distance to Centerline:** 3/4 Mile

12 Viewpoint Location — Route 2 — Route 3



valley link SM

Existing Conditions

Proposed Conditions

Photo simulations are for discussion purposes only. Final design is subject to change pending public, engineering, and regulatory review.

Joshua Falls to Yeat


765kV Electric Transmission Line Project

Viewpoint 13

Date: 10/9/2025 **Time:** 3:57 pm **Viewing Direction:** South

Crossroad: Paradise Rd & Vineyard Rd **Distance to Centerline:** 382 Feet

13 Viewpoint Location — Appomatox Variation

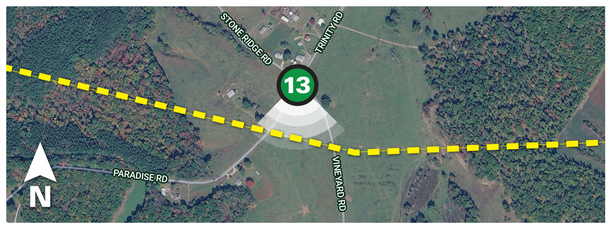

valley link SM